



THIRD FLOOR - SECURITY

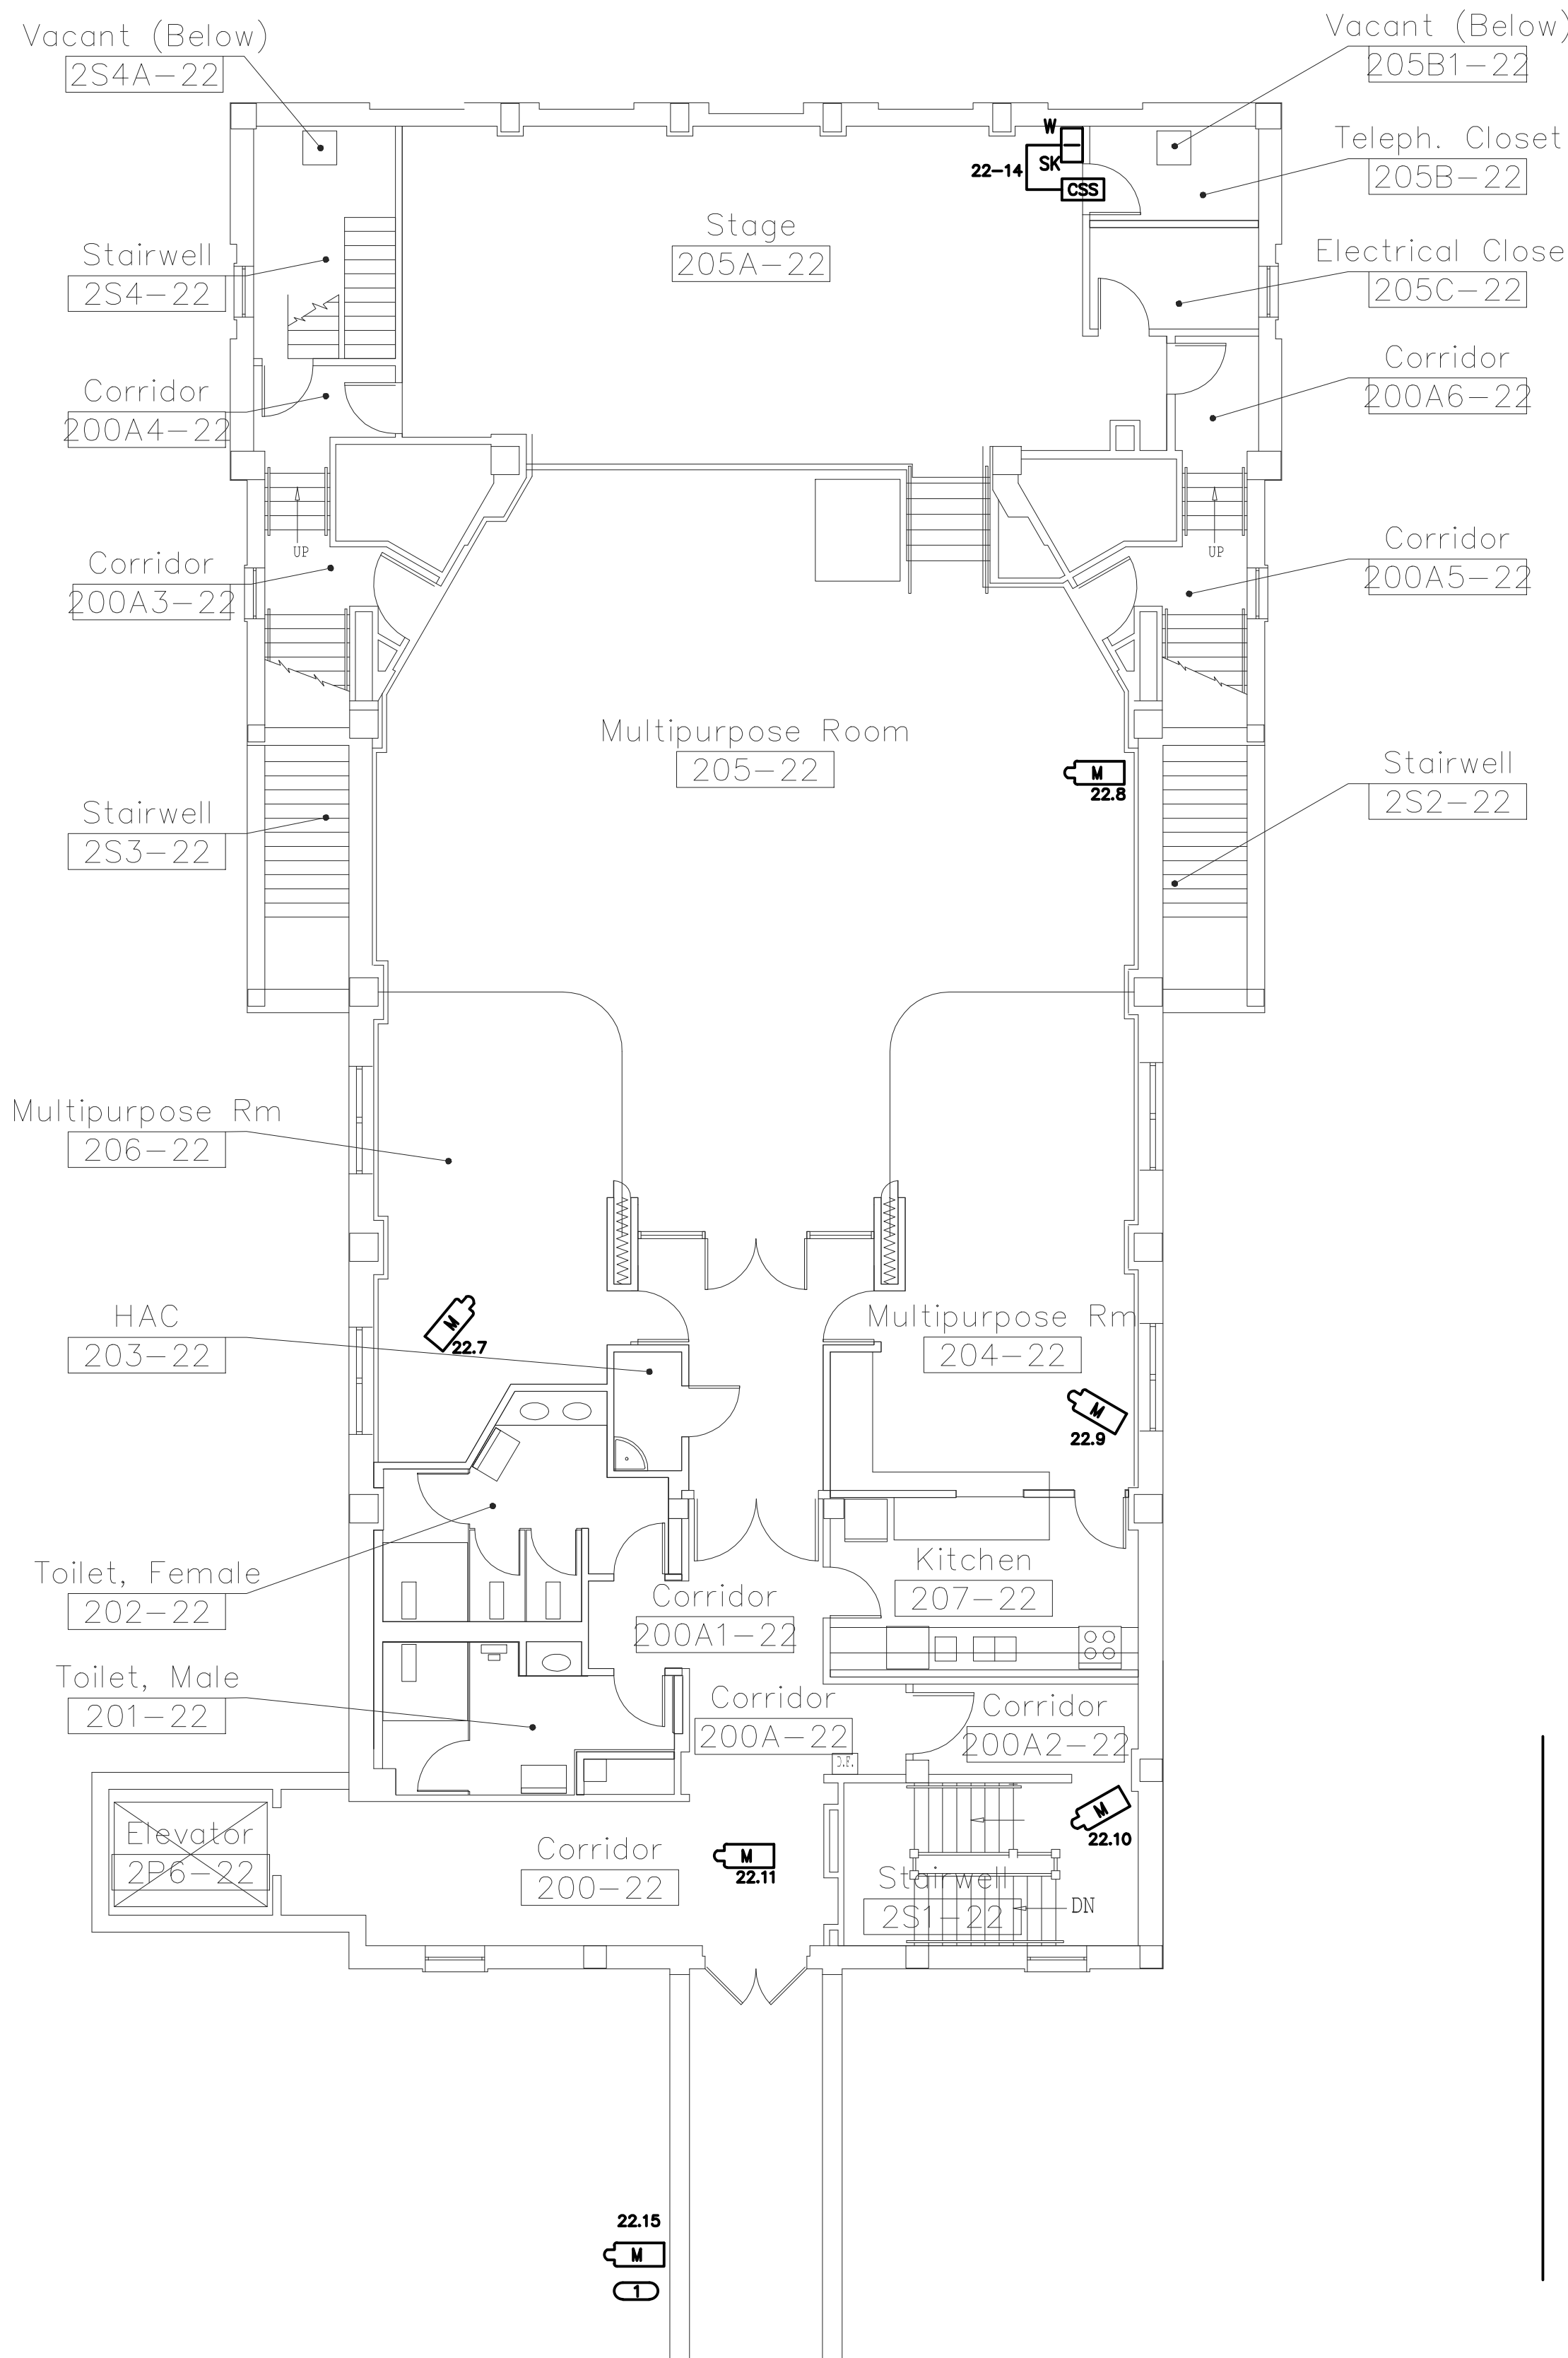

SECONDARY SCC - ROOM ENLARGEMENT

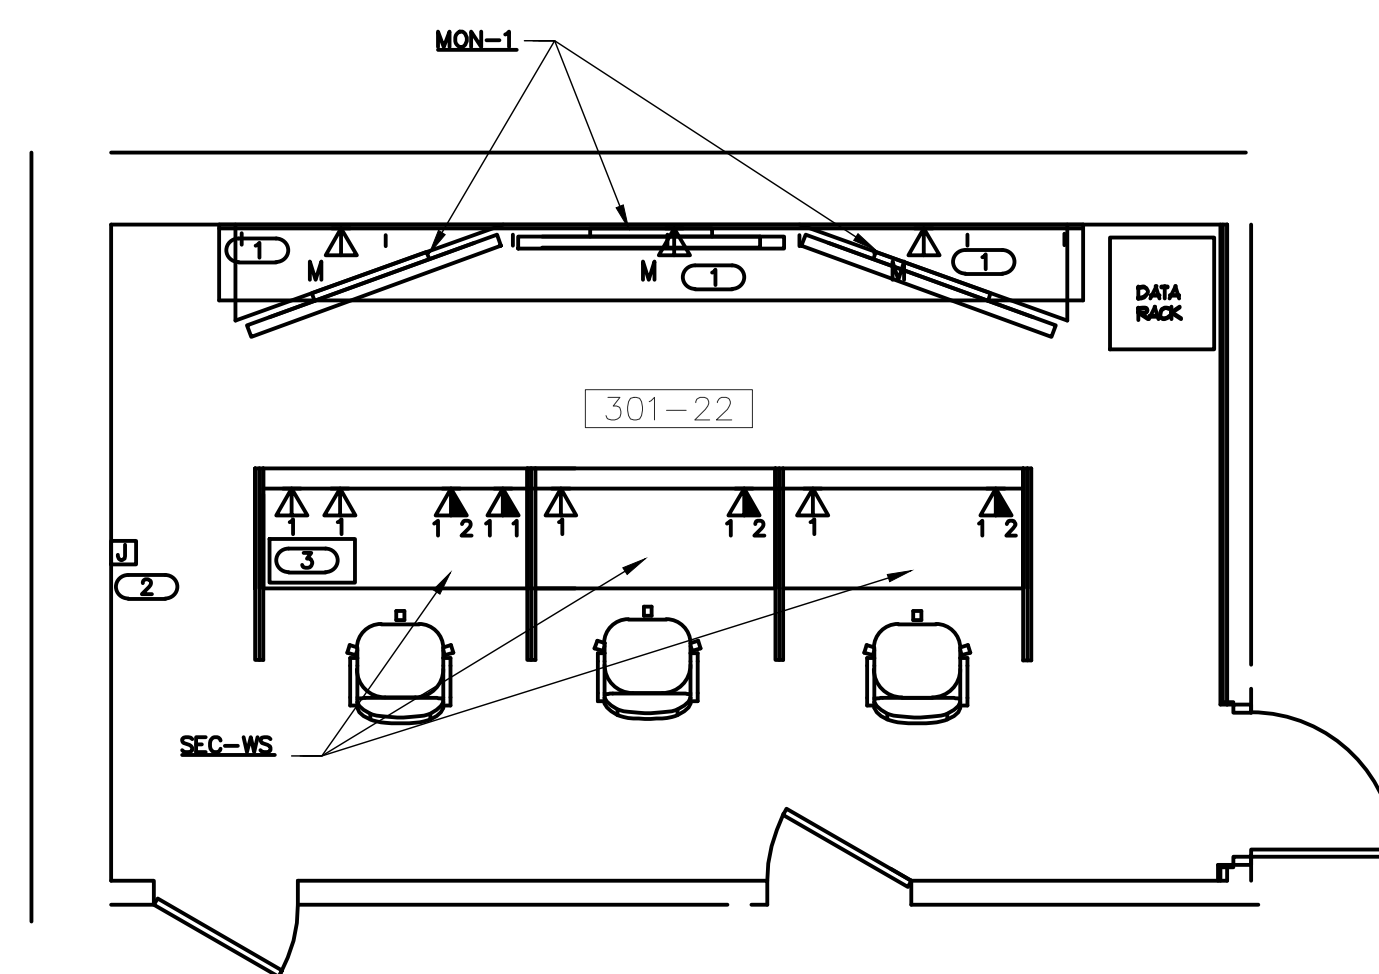

SECONDARY SCC - ROOM ENLARGEMENT

KEYNOTES

- ① ONE LARGE MONITOR SHALL BE CONNECTED TO EACH WORKSTATION. MONITOR SHALL CONNECT TO WALL PLATE, WITH WALL PLATE CONNECTED TO WORKSTATION, EITHER DVI OR HDMI, DEPENDING ON OUTPUTS AVAILABLE ON CONTRACTOR SELECTED MONITOR. DESKTOP MONITORS SHALL CONNECT TO WORKSTATION EITHER DVI OR VGA.
- ② PROVIDED 4"x4" JUNCTION BOX WITH TWO (2) 1-1/4" CONDUITS TO ABOVE CEILING VOID. PROVIDE WHIP INTO FURNITURE RACEWAY. COORDINATE WITH FURNITURE PROVIDER.
- ③ NEW ZETRON RADIO CONSOLE TO BE INSTALLED HERE, CONSISTING OF RADIO-CON, RADIO-CABD, RADIO-MID, RADIO-CARG, RADIO-CABF, RADIO-ARF, RADIO-SW AND RADIO-PS FUNCTIONALITY SHALL BE PROVIDED. PART OF THE RADIO CONSOLE SHALL BE PROVIDED BY SECURITY COMMAND CENTER (SCC). EXACT PLACEMENT ON DESK TO BE DETERMINED BY OWNER.

Date: 08.23.13

Project No. 623.12.105

Drawing No. 22 TY102

Dwg. 74 or 122

ISSUED FOR CONSTRUCTION



Department of
Veterans Affairs